




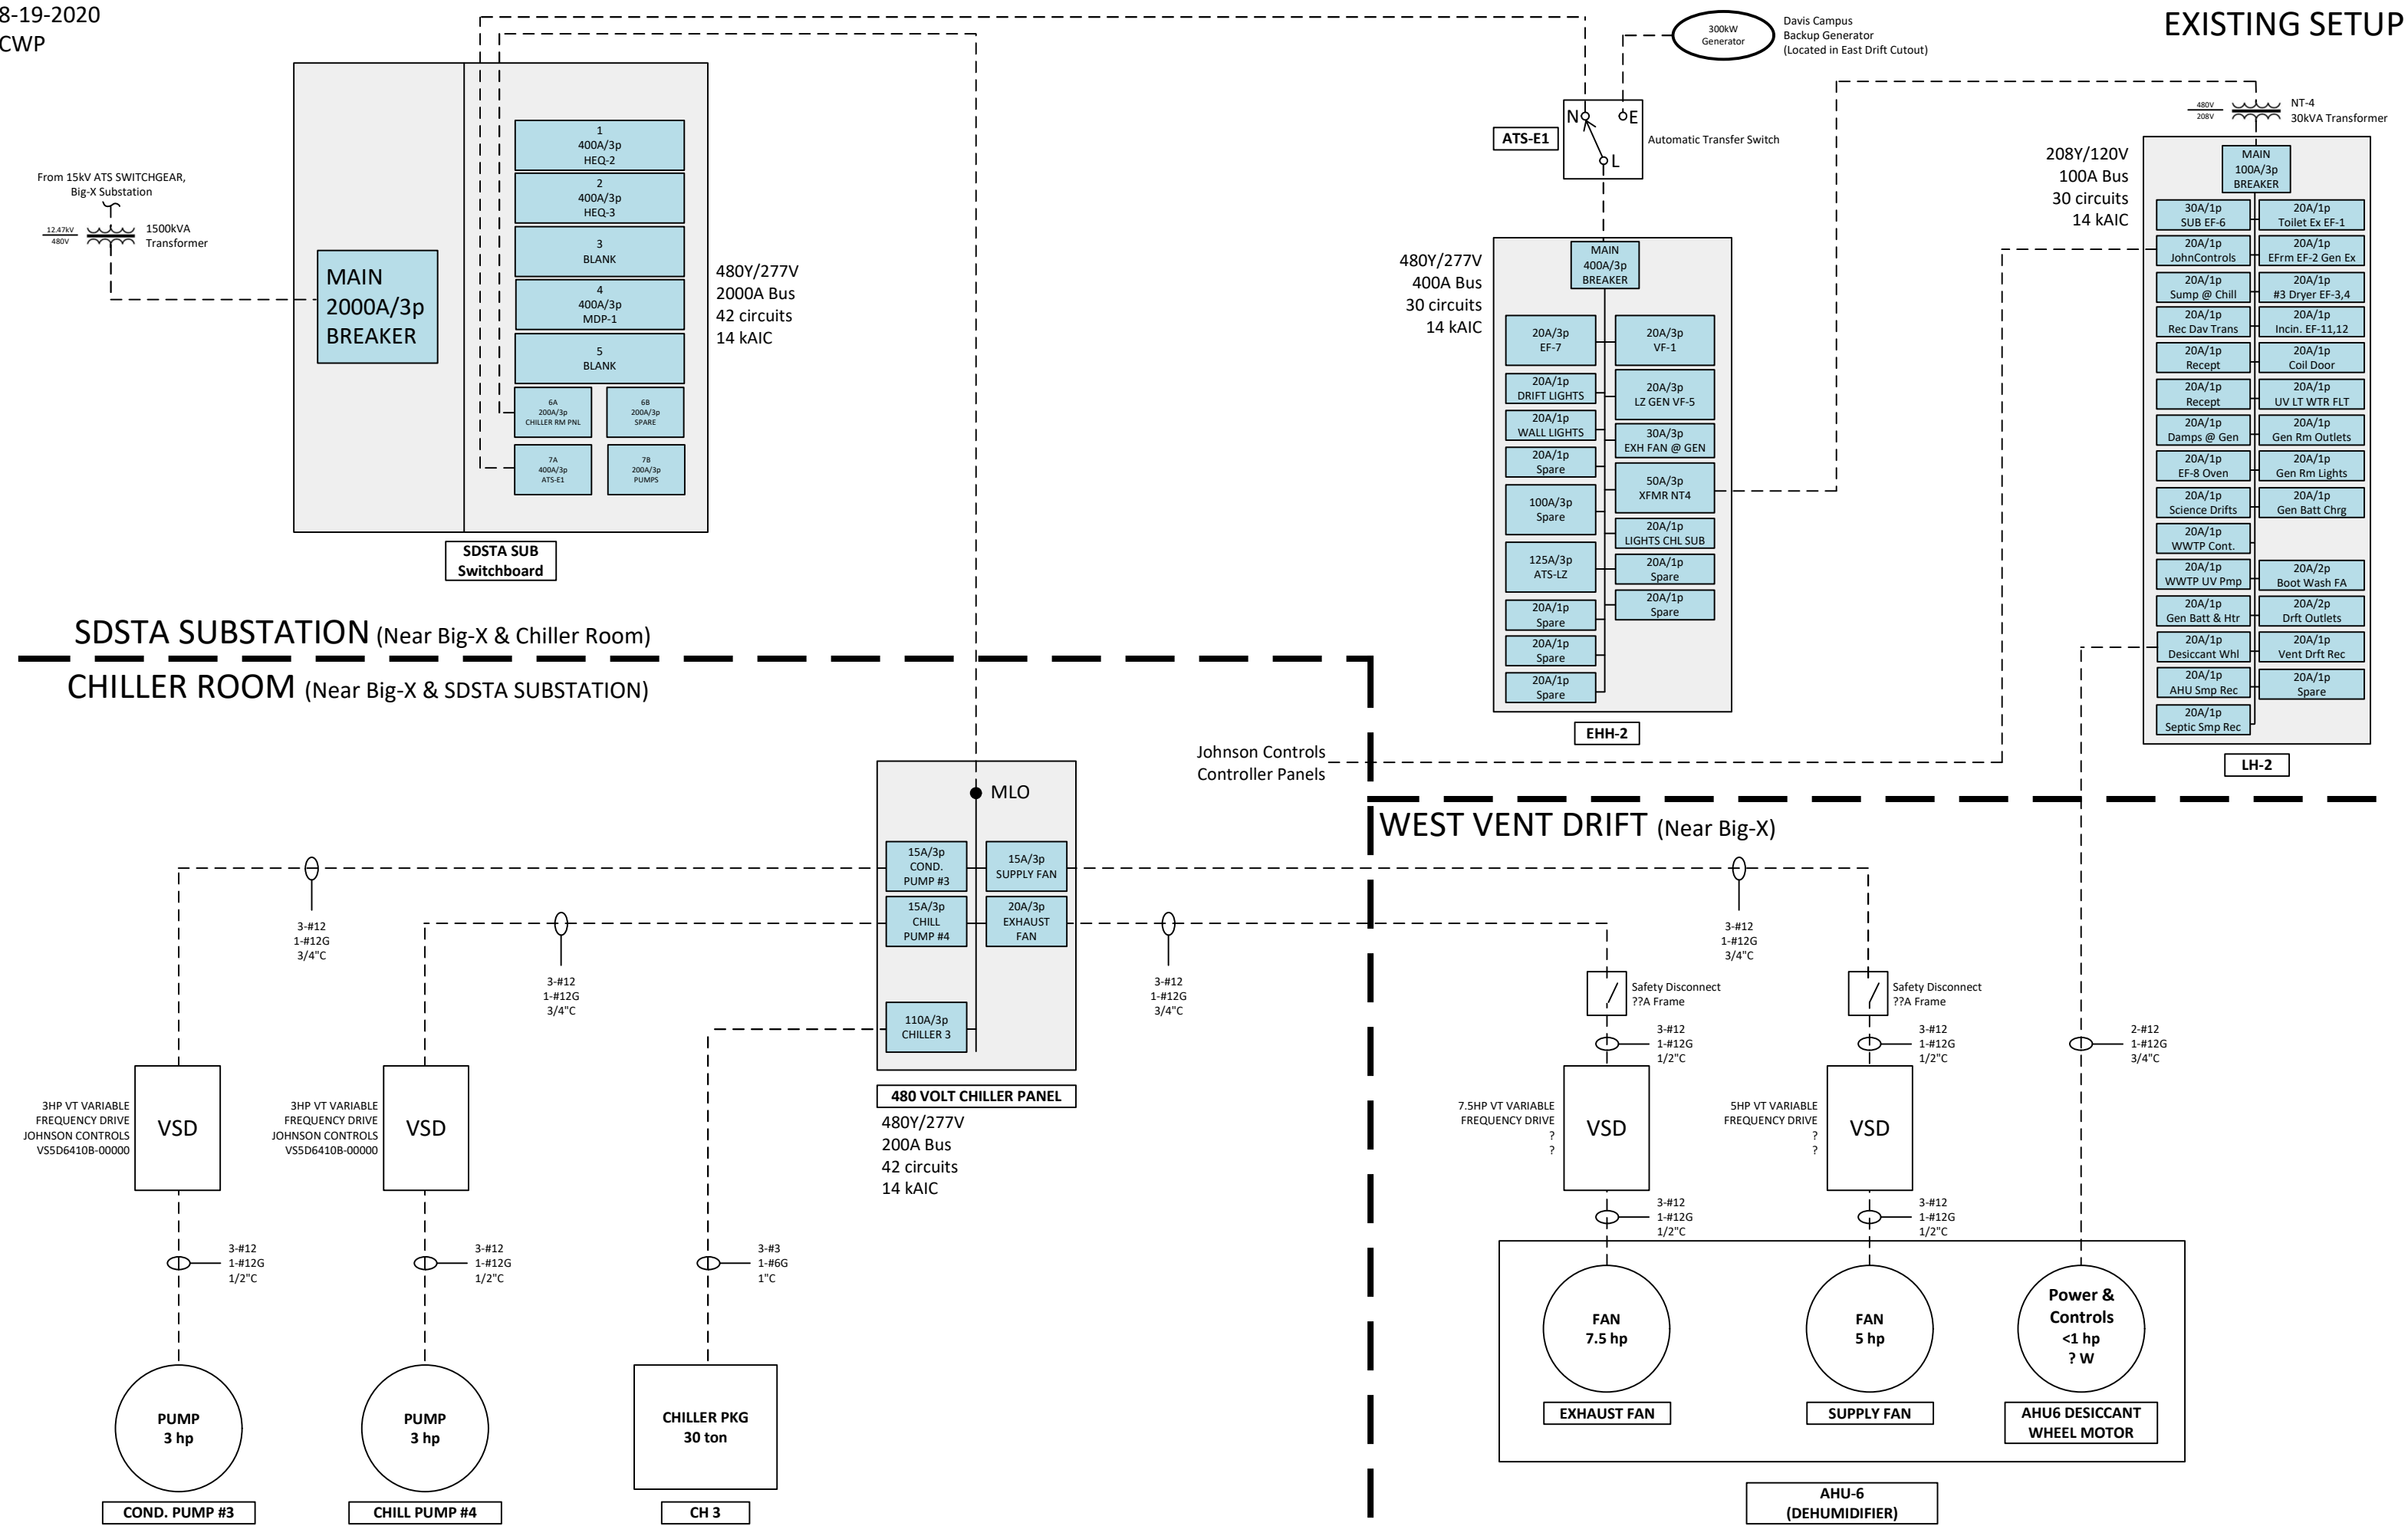

SYSTEM ENABLE

True

SYSTEM RESET

Off

CHW Leaving Temp

43.0 deg F

Chiller3

TO AHU 6

Flow Switch

On

CHW Entering Temp

52.1 deg F

CW Leaving Temp

126.3 deg F

CW Entering Temp

115.8 deg F

Flow Switch

On

CHWP-4

On

On

Normal

CWP 3

On

On

Normal

TO AHU 6

Chiller 3

On

Normal

Air Handler Unit 6

Commands/Status

Application Mode	Auto
Heat Recovery Enable	On

