
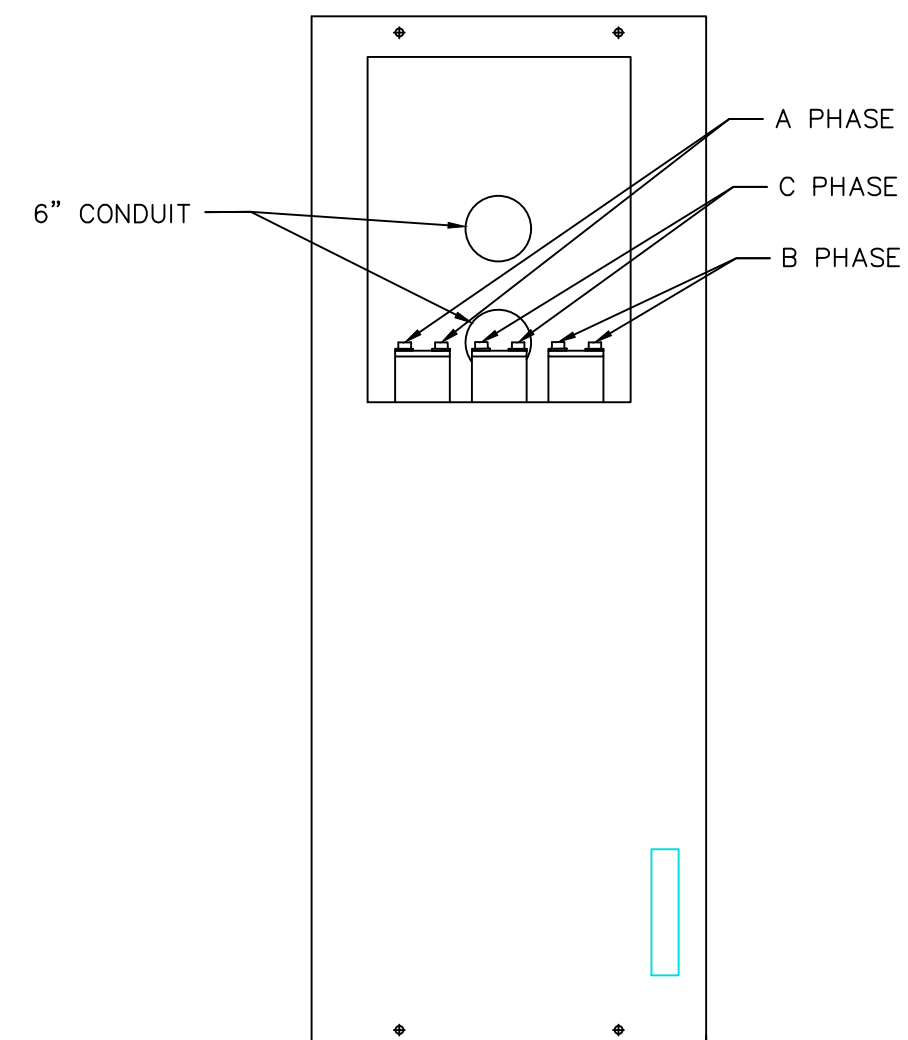


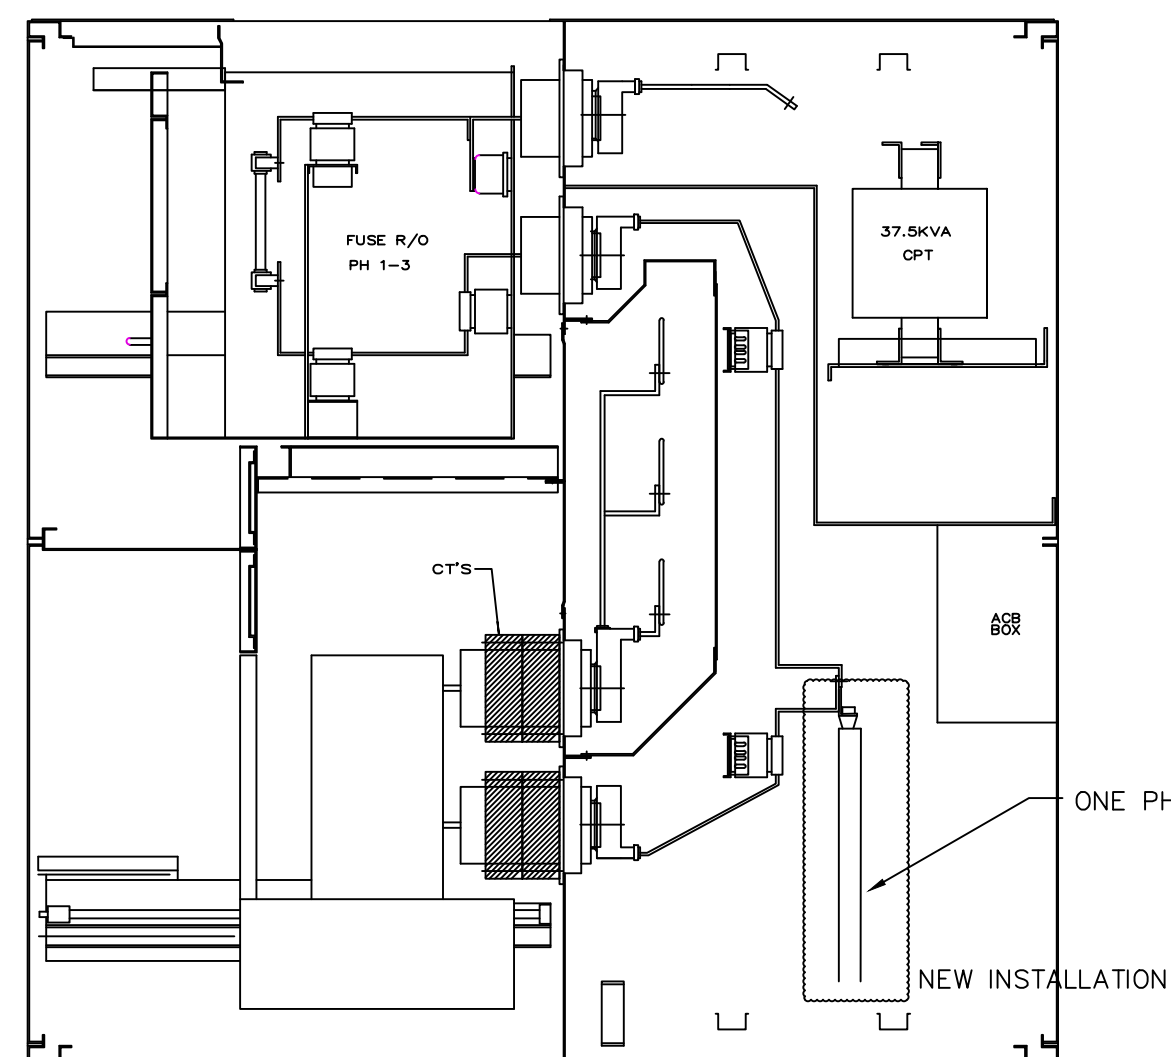

- 1 CABLE ACCESSORIES:
 - A. TERMINATIONS:
 1. LIVEFRONT TERMINATION CONNECTORS:
 - A. STANDARD: IEEE 386.
 - B. VOLTAGE RATING: SAME AS THE CABLE RATING.
 - C. ONE--PIECE DESIGN, MOLDED 8--SKIRT SILICONE RUBBER COLD SHRINK TERMINATION
 - D. LIVEFRONT, DEADBREAK TYPE WITH:
 - 1) ALUMINUM TWO HOLE COMPRESSION LUG.
 - 2) TEMPERATURE RATING: TYPE MV-90 OR MV-105.
- 2 INSTALLATION
 - A. INSTALL PER MANUFACTURER'S RECOMMENDATION
 - B. PERFORM INSPECTIONS AND TESTS PER MANUFACTURER'S RECOMMENDATION IN PRESENCE OF ENGINEER.


PHASE	COLOR	BANDING	DESCRIPTION
A	RED	SINGLE	15KV CABLE TOWARD EAST SUBSTATION
A	RED	DOUBLE	15KV CABLE AWAY FROM EAST SUBSTATION
B	ORANGE	SINGLE	15KV CABLE TOWARD EAST SUBSTATION
B	ORANGE	DOUBLE	15KV CABLE AWAY FROM EAST SUBSTATION
C	BLACK	SINGLE	15KV CABLE TOWARD EAST SUBSTATION
C	BLACK	DOUBLE	15KV CABLE AWAY FROM EAST SUBSTATION

BAY 108 CROSS SECTION

- NOTE:
1. ATTACH CABLE SHIELDS TO SWITCHGEAR GROUND BUS BAR WITH 4/0 GROUNDING CONDUCTOR
 2. NOT ALL PHASE CABLES SHOWN.
 3. NOT TO SCALE

BAY 108 FLOOR PLAN

- NOTE:**
1. ATTACH CABLE SHIELDS TO SWITCHGEAR GROUND BUS BAR WITH 4/0 GROUNDING CONDUCTOR
 2. TWO CABLES PER PHASE ATTACHED TO BUS BAR WITH NEMA 2 HOLE PADS
 3. CABLES TO BE TAPED AS SPECIFIED ON THIS SHEET
 4. NOT TO SCALE

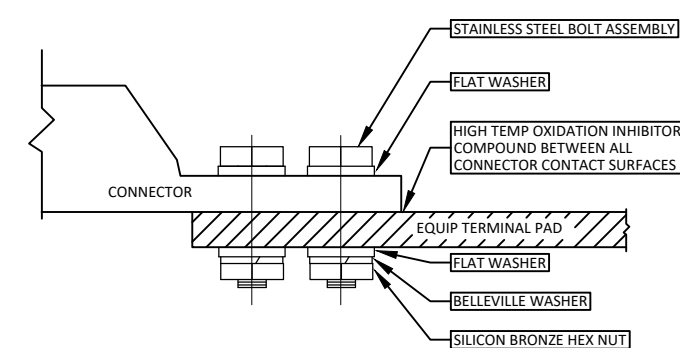

CABLE TERMINATION PAD TO EQUIPMENT PAD

- NOTE:
1. NOT TO SCALE

			PROJECT MANAGER		Nevor Hauck
0	6/8/22	ISSUE_FOR_CONSTRUCTION			
ISSUE	DATE	DESCRIPTION	PROJECT NUMBER		10333743

